

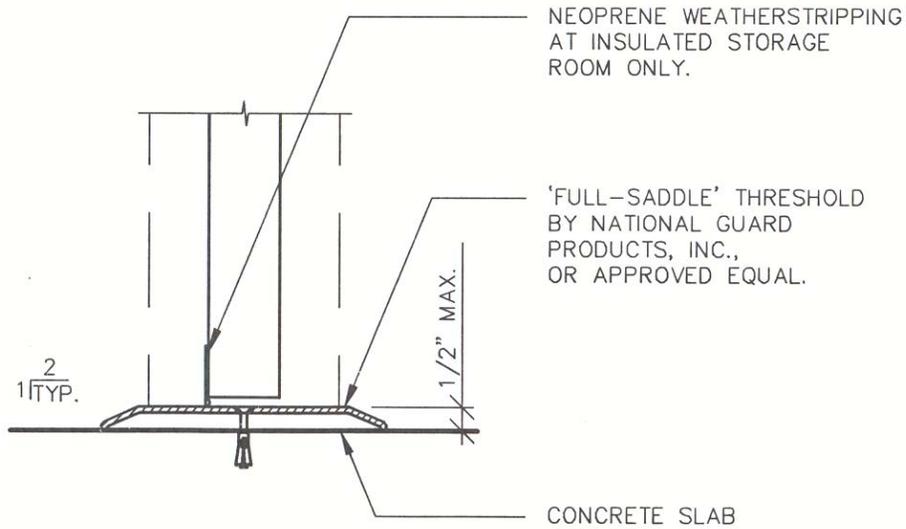


# UNISEX RESTROOM FLOOR PLAN

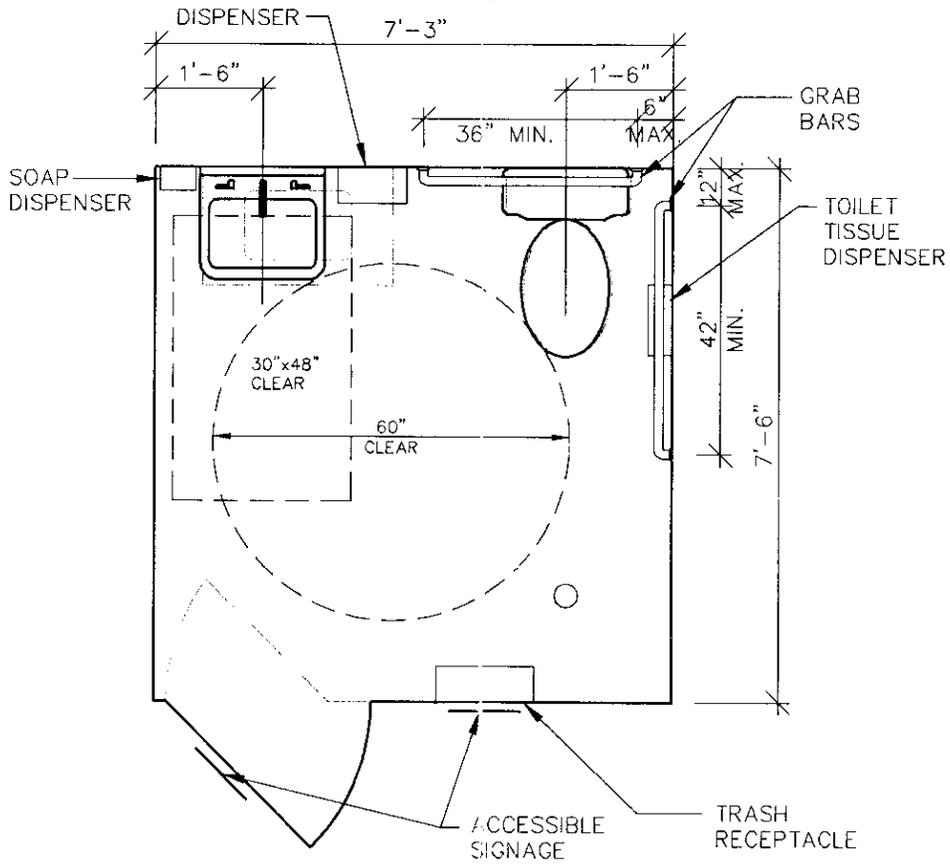


All forms and handouts are available on [www.cityofnapa.org](http://www.cityofnapa.org)

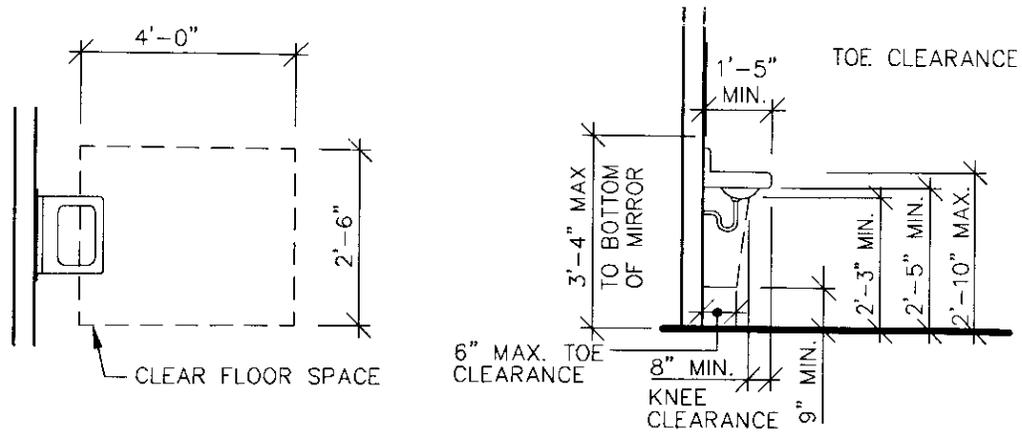

**LAVATORY NOTES:**


1. PROVIDE A CLEAR SPACE 30"x48" MIN. IN FRONT OF THE LAVATORY. THE CLEAR SPACE MAY EXTEND INTO KNEE SPACE UNDER LAVATORY.
2. INSULATE OR CONFIGURE HOT WATER SUPPLY AND DRAIN PIPING UNDER LAVATORIES TO PREVENT CONTACT.
3. NO SHARP OR ABRASIVE ELEMENTS ARE ALLOWED UNDER LAVATORIES.
4. FAUCET CONTROLS AND OPERATING MECHANISMS ARE REQUIRED TO BE OPERABLE WITH ONE HAND AND CANNOT REQUIRE GRASPING, PINCHING, OR TWISTING OF WRIST. THE FORCE REQUIRED TO ACTIVATE CONTROLS IS NOT TO EXCEED 5 LB. LEVER OPERATED, PUSH TYPE AND ELECTRONICALLY CONTROLLED MECHANISMS ARE EXAMPLES OF ACCEPTABLE DESIGN.
5. SELF CLOSING VALVES ARE ALLOWED IF THE FAUCET REMAINS OPEN FOR AT LEAST 10 SECONDS.

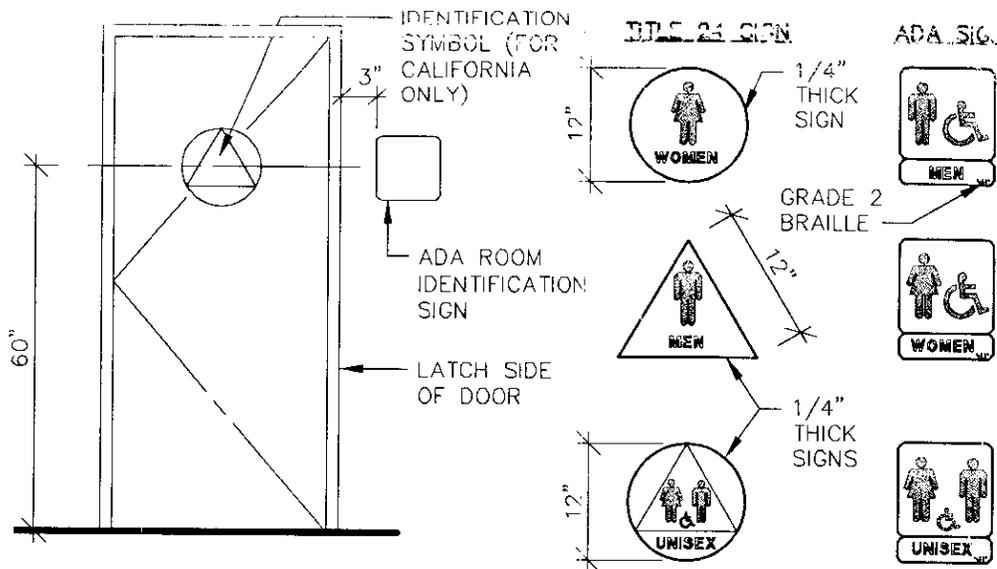


**NOTES**

1. CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUND.
2. IDENTIFICATION SYMBOLS ARE TO BE CENTERED ON DOOR 60" ABOVE FLOOR AND ARE TO BE DISTINCTLY DIFFERENT FROM THE DOOR IN COLOR AND CONTRAST.
3. BOTH TITLE 24 SIGNS AND ADA SIGNS ARE REQUIRED IN CALIFORNIA.
4. PROVIDE ROOM IDENTIFICATION SIGN ON LATCH SIDE OF DOOR.
5. LETTERS & NUMBERS ON SIGNS SHALL BE RAISED 1/32" MIN., SHALL BE A MIN. OF 5/8" HIGH & SHALL BE SANS-SERIF UPPERCASE CHARACTERS ACCOMPANIED BY GRADE 2 BRAILLE.

All forms and handouts are available on [www.cityofnapa.org](http://www.cityofnapa.org)

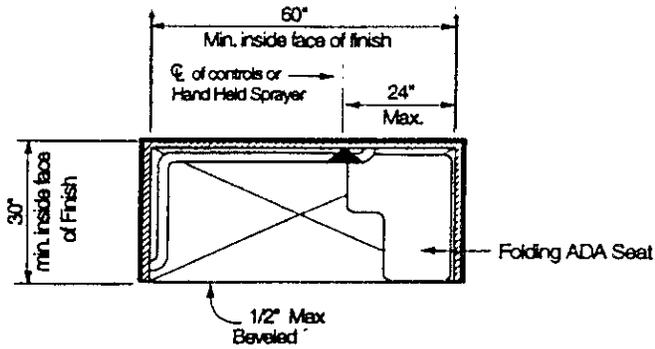


ROLL-IN SHOWER—A

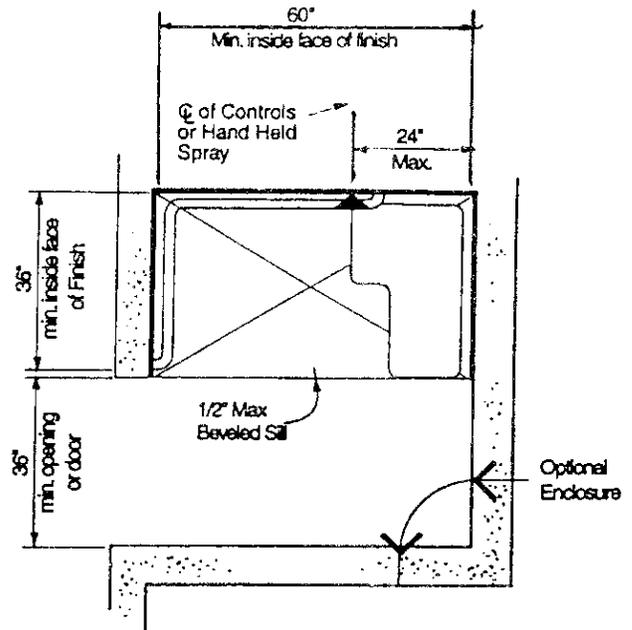


PLAN


ROLL-IN SHOWER—C  
 36" x 60" WITH ENCLOSURE

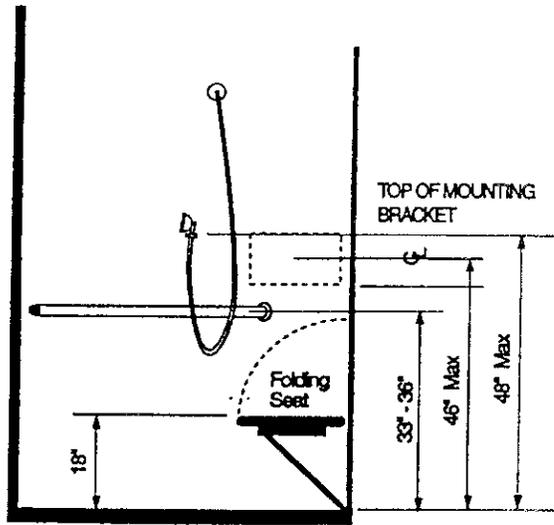


ELEVATION AT SHOWER  
 TYPICAL FOR A-C

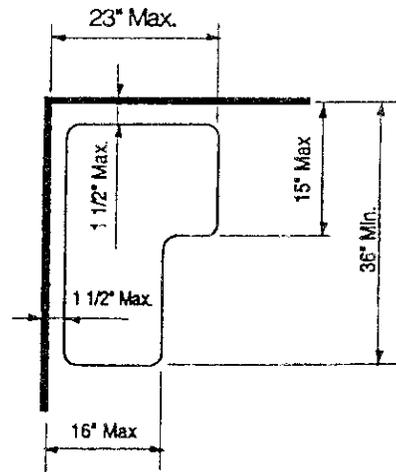



SHOWER SEAT

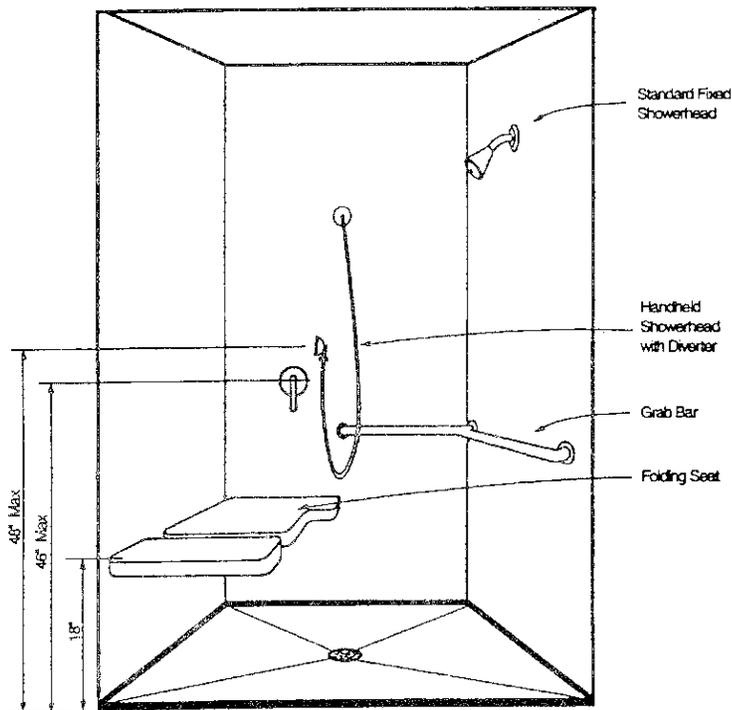


PERSPECTIVE OF ROLL-IN SHOWER---B  
42" x 48" CALIFORNIA SIZE

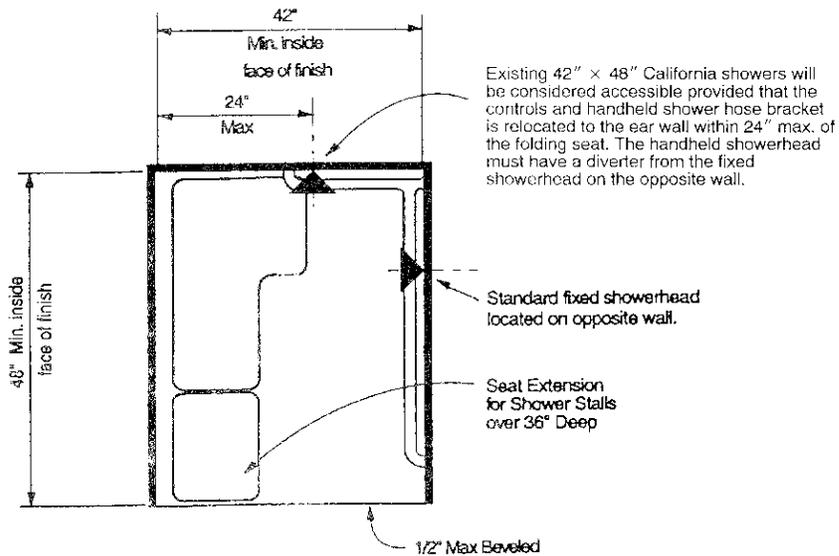

ROLL-IN SHOWER  
42" x 48" CALIFORNIA SIZE

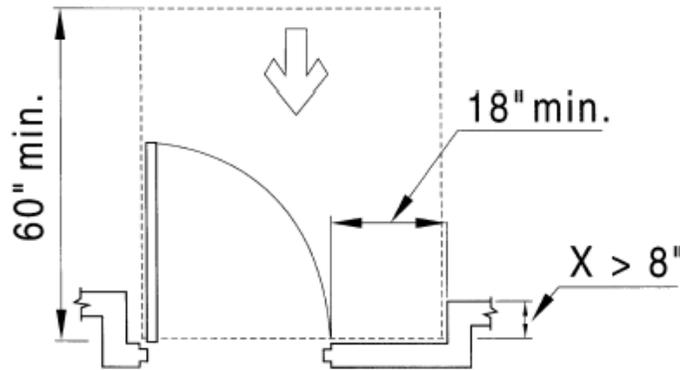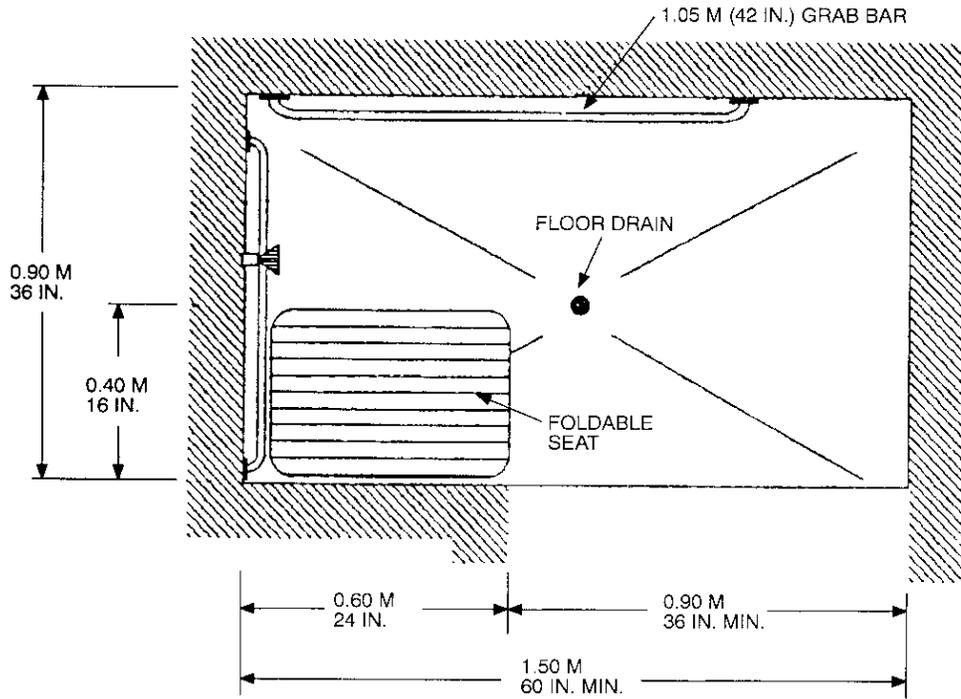


(a) PULL SIDE (INTERIOR DOOR)

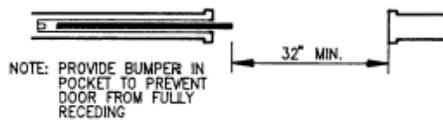

(b) SLIDING DOOR

All forms and handouts are available on [www.cityofnapa.org](http://www.cityofnapa.org)

- A. Minimum 30" x 48" clear space is provided in front of sink that allows forward approach.
- B. Required clear space adjoins or overlaps an accessible route.
- C. 34" maximum height of rim or counter above floor surface.
- D. Sink is a maximum of 6-1/2" deep.
- E. Knee clearance under sink is a minimum of 27" high and 30" wide, and provides an absolute depth of 19" underneath the sink.
- F. Drain and hot water piping is insulated or configured to prevent contact.
- G. There are no sharp or abrasive elements under sink.
- H. Faucets are lever type, push type or electronically controlled mechanisms (or other similar designs).  
**NOTE:** Self closing valves must maintain a minimum of 10 second open flow. **1115B.2.1.6.1 & .2**
- I. Faucets are operable with one hand and do not require tight grasping, pinching or twisting of the wrist. **1115B.2.1.6.1 & .2**
- J. 5 lb. maximum force required to activate controls. **1115B.2.1.6.1 & .2**

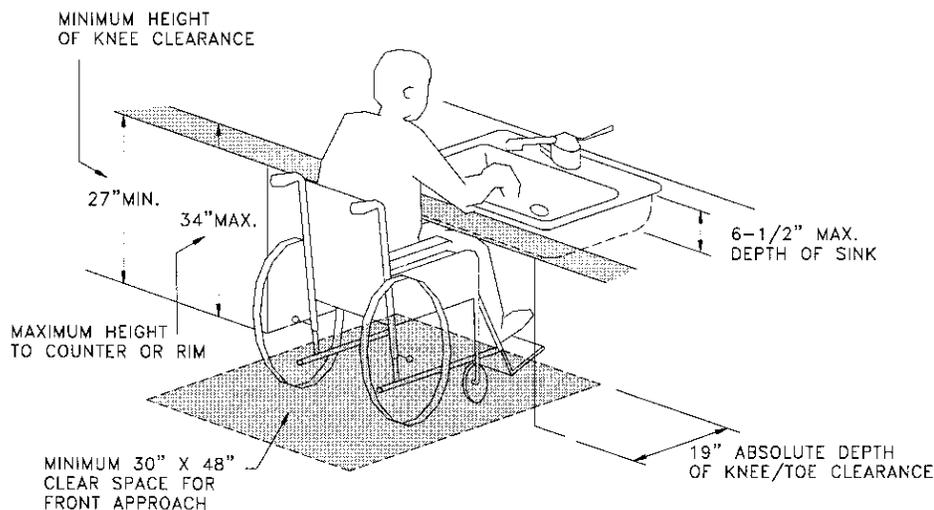

## SINKS