

Community Development Department

1600 First St., P.O. Box 660 Napa, CA 94559-0660

Engineering Division
Phone: (707) 257-9530

Planning Division
Phone: (707) 257-9530

Building Division
Phone: (707) 257-9540
Inspections: (707) 257-1063

Facsimile: (707) 257-9522







Napa Fire Department
Fire Prevention Division
Phone: (707) 257-9590



POOL ELECTRICAL EQUIPMENT

GENERAL NOTES:

1. WHERE GROUNDING CLAMPS ARE USED, THEY SHALL BE LISTED FOR THAT PURPOSE.
2. LOCATE DECK BOX TO COMPLY WITH SEC. 680-21 (e) OF THE NEC CODE. SEE DETAIL-B.
3. ALL METAL FITTINGS WITHIN 5' OF THE POOL MUST BE BONDED TO THE POOL REINFORCING BAR WITH A #8 AWG SOLID COPPER CONDUCTOR UNLESS COMPLYING WITH SEC. 680-22
4. THE PUMP(S), FILTER, HEATER SHALL BE BONDED TOGETHER WITH A #8 SOLID COPPER CONDUCTOR & MOUNTED SECURELY TO A CONCRETE SLAB.
5. ALL ELECTRICAL FIXTURES MUST BE UL LISTED.
6. ALL OUTDOOR RECEPTACLES TO BE PROTECTED BY A G.F.C.I. ALL OUTDOOR RECEPTACLES SHALL BE AT LEAST 10' FROM THE INSIDE EDGE OF THE POOL.
7. WIRE MESH & REINFORCING BARS MUST BE TIED TO FORM AN ADEQUATE GROUND PATH PER NEC ARTICLES 260 & 680. THE POOL EQUIP MUST BE BONDED TO THE POOL REINFORCING STEEL.
8. DETAIL-B IS REQUIRED FOR BONDING ONLY WHEN METAL PIPING IS USED.
9. DETAIL-C ILLUSTRATES A TYPICAL METHOD FOR BONDING GRAB RAILS, HAND RAILS, LADDERS, ETC.

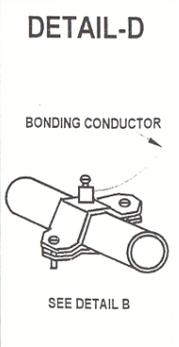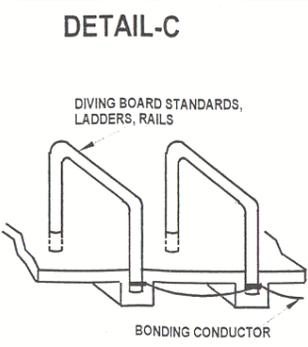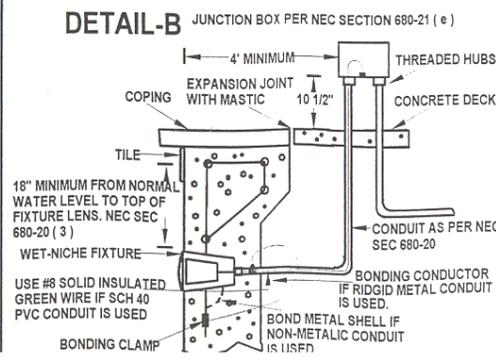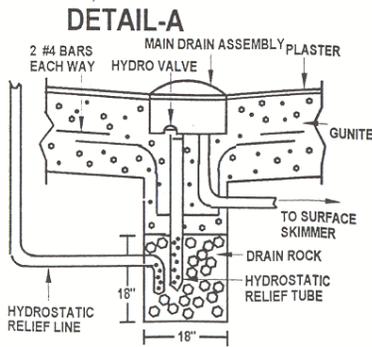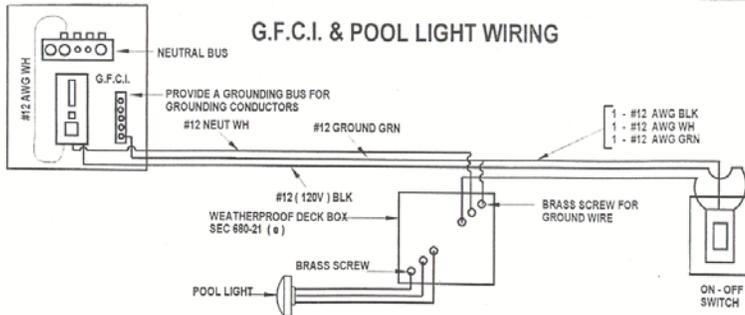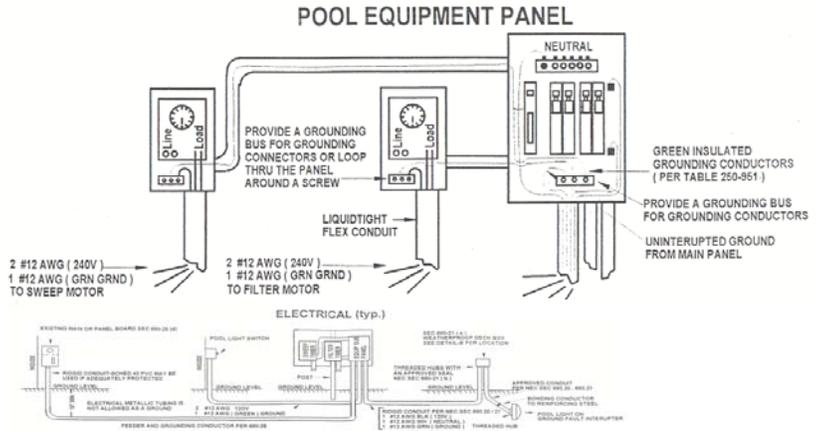

All forms and handouts are available on www.cityofnapa.org