


ALTERNATE MATERIALS MUST BE APPROVED BY THE CITY OF NAPA WATER DIVISION PRIOR TO USE

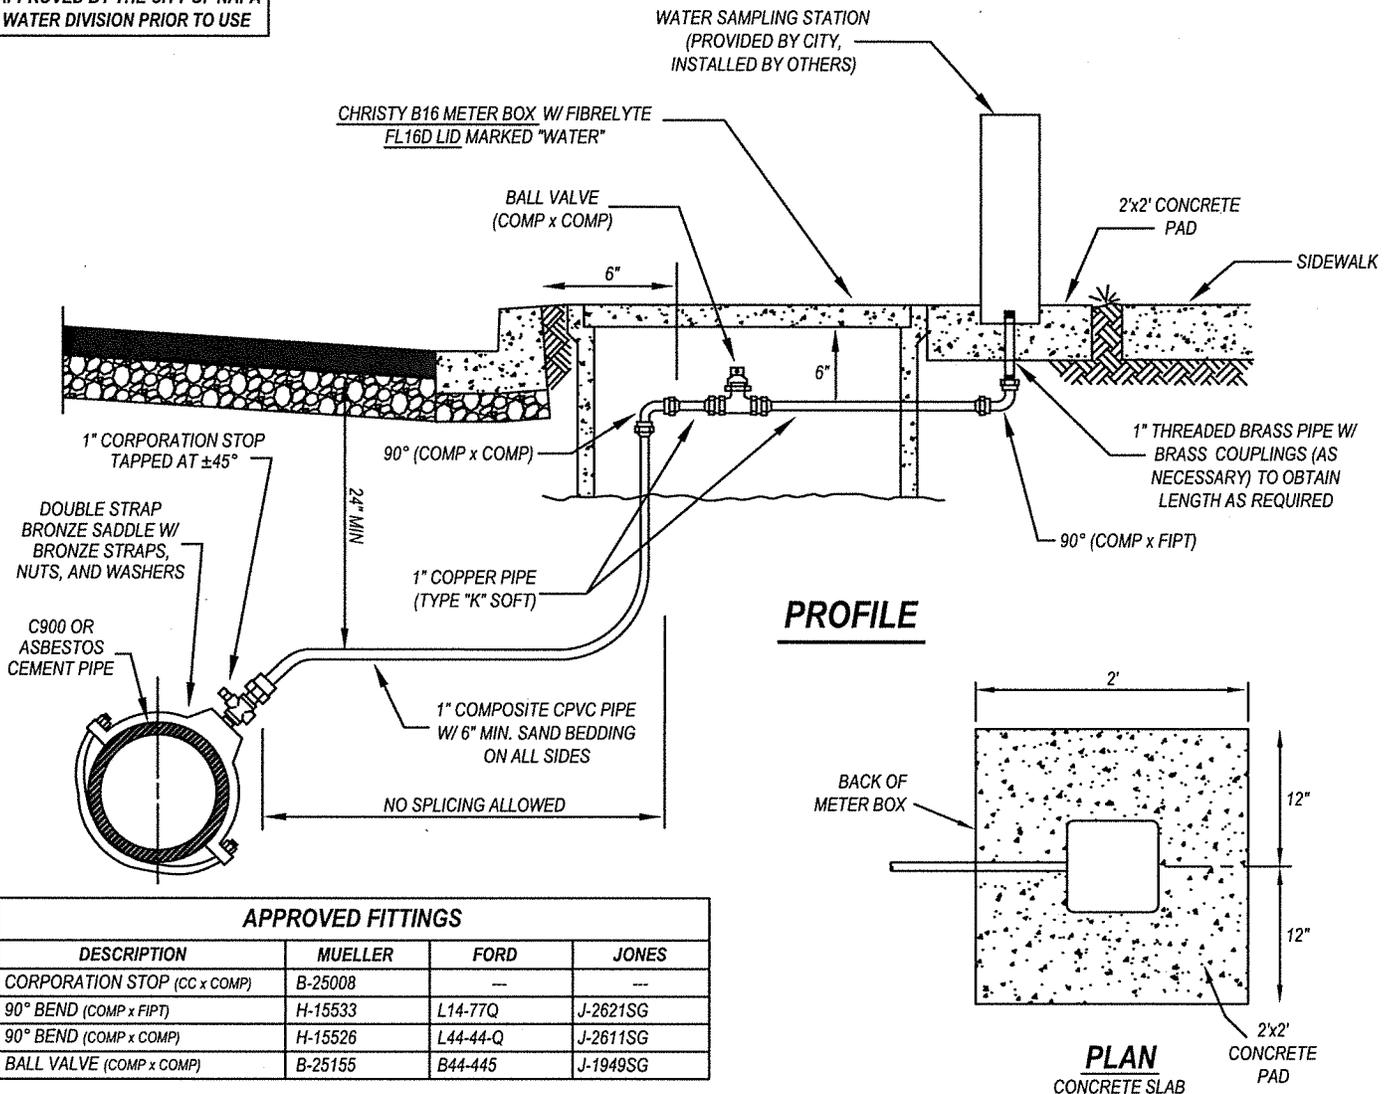

APPROVED FITTINGS

DESCRIPTION	MUELLER	FORD	JONES
CORPORATION STOP (CC x COMP)	B-25008	---	---
90° BEND (COMP x FIPT)	H-15533	L14-77Q	J-2621SG
90° BEND (COMP x COMP)	H-15526	L44-44-Q	J-2611SG
BALL VALVE (COMP x COMP)	B-25155	B44-445	J-1949SG

NOTES

1. WATER SAMPLING STATIONS SHALL BE INSTALLED DURING THE CONSTRUCTION NEW WATER MAINS AS DIRECTED BY THE CITY WATER QUALITY MANAGER, AND AT OTHER SPECIFIED LOCATIONS AS REQUIRED.
2. ALL BURIED SECTIONS OF COPPER AND BRASS PIPE SHALL BE WRAPPED WITH AN 8-MIL PLASTIC SLEEVE (BLUE IN COLOR). COPPER PIPE NOT WRAPPED IN A PLASTIC SLEEVE SHALL BE NSF 61 APPROVED PLASTIC COATED COPPER TUBING (TYPE "K" SOFT, BLUE IN COLOR).
3. METER BOX AND SERVICE LINE SHALL BE INSTALLED 5-FT (MIN) FROM DRIVEWAY APPROACHES AND OTHER VEHICULAR ACCESS WAYS.
4. EXISTING WATER MAINS SHALL BE HOT-TAPPED BY CITY FORCES AT DEVELOPER'S EXPENSE. SEE W-16 FOR HOT-TAP REQUIREMENTS. HOT TAP SHALL BE 24" (MIN) FROM ANY OTHER TAP, BELL, FITTING, OR OTHER SERVICE.
5. WATER SAMPLING STATIONS SHALL NOT BE INSTALLED OFF EXISTING SERVICE LATERALS UNLESS OTHERWISE APPROVED BY THE CITY WATER QUALITY MANAGER.
6. METER BOXES SHALL BE PLACED A MINIMUM OF 3' FROM ANY OBSTRUCTION (SIGN POST, MAIL BOX, FENCES, WALLS, ETC.). NO TREES SHALL BE PLANTED WITHIN 10' OR LARGE SHRUBS WITHIN 5' OF THE METER BOX. SEE W-18 FOR ADDITIONAL REQUIREMENTS.

CITY OF NAPA

PUBLIC WORKS - WATER DIVISION

**WATER SAMPLING STATION
(AC AND C900 WATER MAINS)**

DATE REVISED: DECEMBER 2015

CHECKED:

APPROVED:

SCALE: NONE

DWG NO.

W - 10E