


TEST STATION DETAIL

NOT TO SCALE

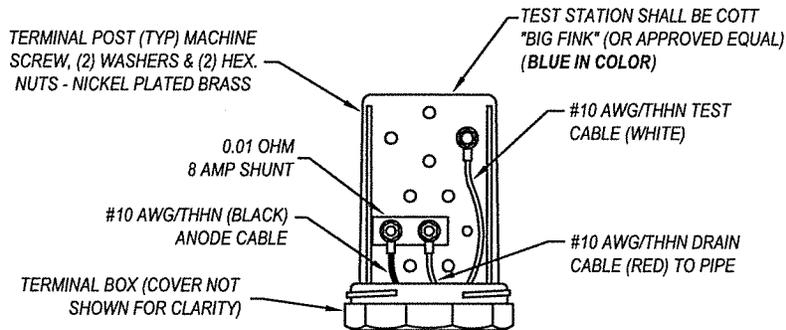

ATS TERMINAL BOX

NOT TO SCALE

NOTES

1. CONTRACTOR TO PROVIDE TERMINAL BOX (WITH SHUNT) FOR THE WATER DIVISION CORROSION SPECIALIST TO INSTALL AT TEST STATION LOCATIONS.
2. ALL TEST STATIONS SHALL BE INSTALLED BEHIND THE BACK OF CURB, OUTSIDE OF ALL DRIVEWAYS AND DRIVEWAY APPROACHES, UNLESS OTHERWISE PERMITTED BY THE WATER DIVISION CORROSION SPECIALIST.

CITY OF NAPA

PUBLIC WORKS - WATER DIVISION

TEST STATION AND TERMINAL BOX

DATE REVISED: DECEMBER 2015

CHECKED: *[Signature]*

APPROVED: *[Signature]*

SCALE: NONE

W - 26A

DWG NO.