


**PLAN VIEW**

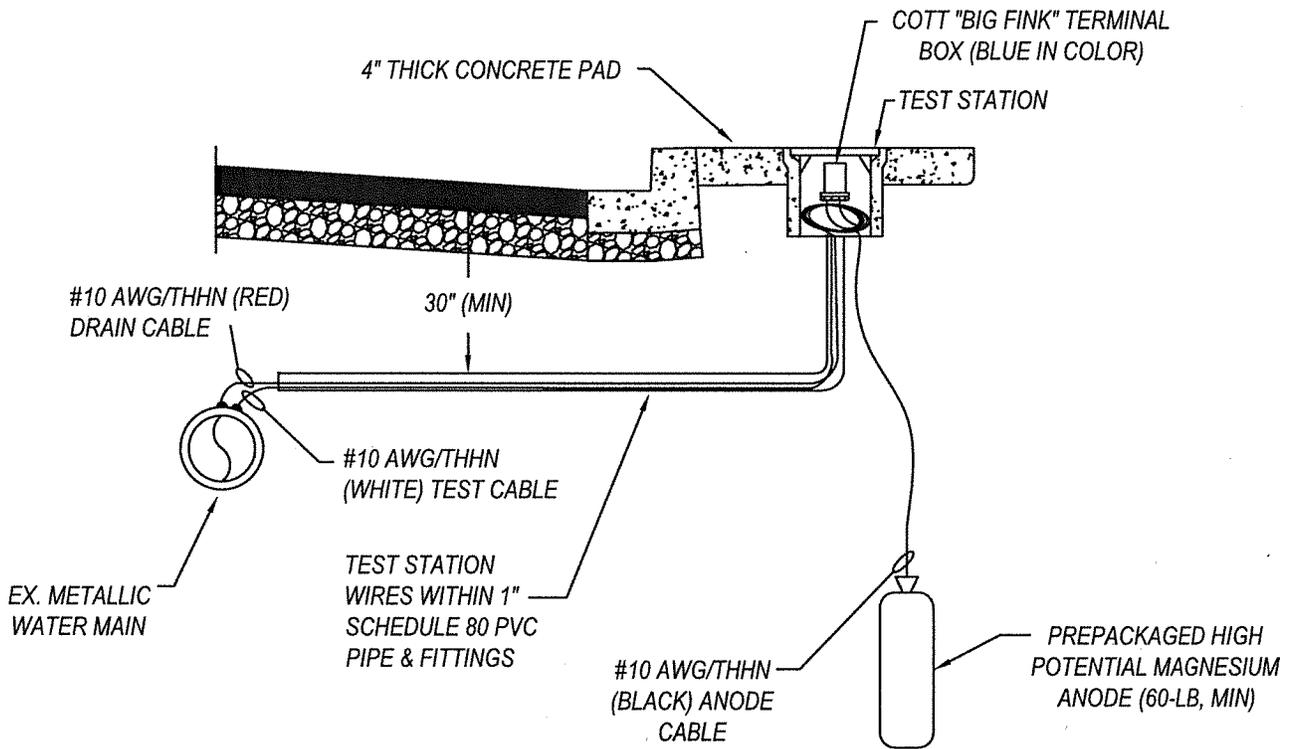

**ELEVATION VIEW**

**NOTES:**

1. CONTRACTOR TO PROVIDE COTT "BIG FINK" TEST STATION AND ASSOCIATED FITTINGS AND BRING WIRES INTO NEW RISER BOX. CONTRACTOR TO ENSURE WIRES IN BOX DO NOT SHORT TO EACH OTHER UNTIL AFTER CITY PERSONNEL TEST WIRE CONNECTIVITY.
2. CITY PERSONNEL SHALL TEST WIRE CONNECTIVITY PRIOR TO INSTALLATION OF TERMINAL BOX.

CITY OF NAPA

PUBLIC WORKS - WATER DIVISION

**EXISTING SYSTEM - ANODE TEST STATION**

DATE REVISED DECEMBER 2015

CHECKED *mfj*

APPROVED *JRT*

SCALE NONE

DWG NO.

**W - 26B**